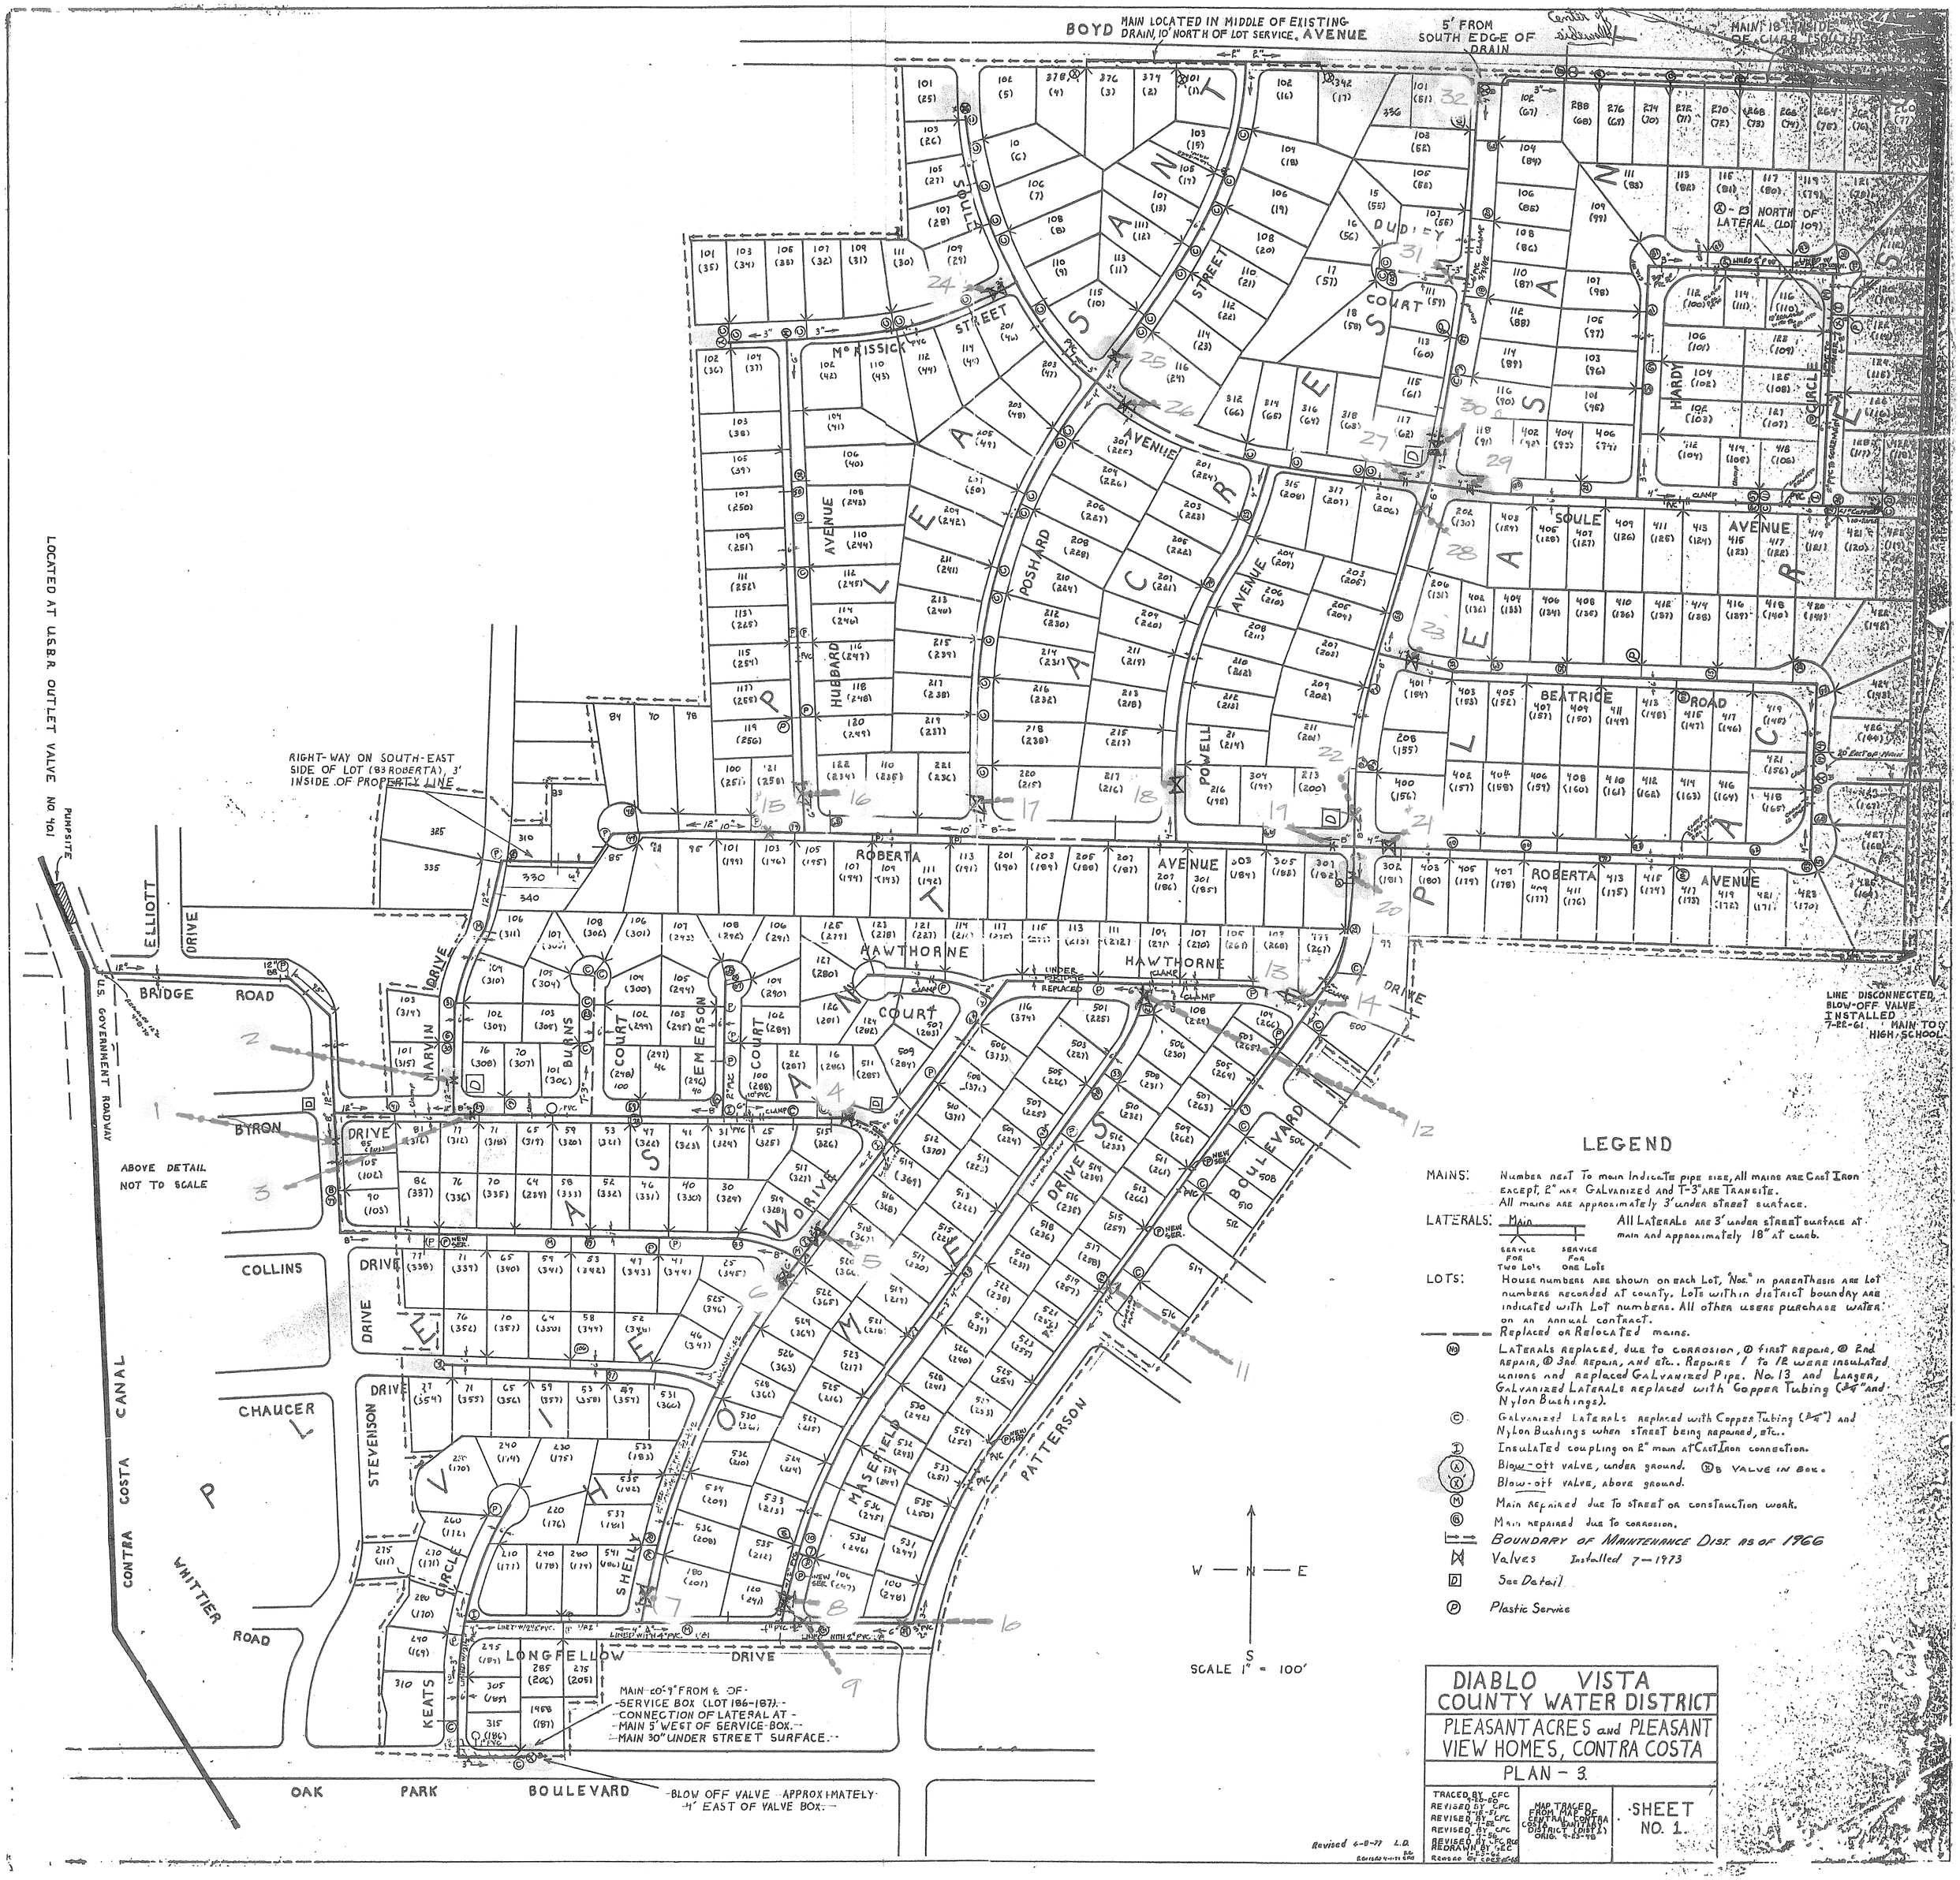

BOYD AVENUE
MAIN LOCATED IN MIDDLE OF EXISTING DRAIN, 10' NORTH OF LOT SERVICE.
5' FROM SOUTH EDGE OF DRAIN
MAIN 18' INSIDE OF CURB (SOUTH)
LOCATED AT U.S.B.R. OUTLET VALVE NO. 401
PUMPSITE
RIGHT-WAY ON SOUTH-EAST SIDE OF LOT (83 ROBERTA), 3' INSIDE OF PROPERTY LINE
LINE DISCONNECTED, BLOW-OFF VALVE INSTALLED 7-22-61. MAIN TO HIGH SCHOOL
ABOVE DETAIL NOT TO SCALE
U.S. GOVERNMENT ROADWAY
CONTRA COSTA CANAL
WHITTIER ROAD
OAK PARK BOULEVARD
BRIDGE ROAD
ELLIOTT DRIVE
BYRON DRIVE
COLLINS DRIVE
CHAUCER DRIVE
STEVENSON DRIVE
KEATS CIRCLE
LONGFELLOW DRIVE
MARVIN DRIVE
BURNS COURT
EMERSON COURT
HAWTHORNE COURT
HAWTHORNE DRIVE
ROBERTA AVENUE
POWELL AVENUE
POSHARD AVENUE
HUBBARD AVENUE
McKISSICK STREET
SOULE STREET
DUDLEY COURT
HARDY CIRCLE
BEATRICE ROAD
SOULE AVENUE
PATTERSON BOULEVARD
MASEFIELD DRIVE
SHELLY DRIVE
MAIN 20'-9" FROM ℄ OF SERVICE BOX (LOT 186-187). CONNECTION OF LATERAL AT MAIN 5' WEST OF SERVICE BOX. MAIN 30" UNDER STREET SURFACE.
BLOW OFF VALVE APPROXIMATELY 4' EAST OF VALVE BOX.
W — N — E
S
SCALE 1" = 100'
LEGEND
MAINS: Number next to main indicate pipe size, all mains are Cast Iron except, 2" are Galvanized and T-3" are Transite. All mains are approximately 3' under street surface.
LATERALS: Main — Service for Two Lots — Service for One Lots. All Laterals are 3' under street surface at main and approximately 18" at curb.
LOTS: House numbers are shown on each Lot, "Nos." in parenthesis are Lot numbers recorded at county. Lots within district boundry are indicated with Lot numbers. All other users purchase water on an annual contract.
Replaced or Relocated mains.
Laterals replaced, due to corrosion, ① first repair, ② 2nd repair, ③ 3rd repair, and etc.. Repairs 1 to 12 were insulated unions and replaced Galvanized Pipe. No. 13 and Larger, Galvanized Laterals replaced with Copper Tubing (3/4" and Nylon Bushings).
Galvanized Laterals replaced with Copper Tubing (3/4") and Nylon Bushings when street being repaired, etc..
Insulated coupling on 2" main at Cast Iron connection.
Blow-off valve, under ground. Ⓧ B Valve in box.
Blow-off valve, above ground.
Main repaired due to street or construction work.
Main repaired due to corrosion.
Boundary of Maintenance Dist. as of 1966
Valves Installed 7-1973
See Detail
Plastic Service
DIABLO VISTA COUNTY WATER DISTRICT
PLEASANT ACRES and PLEASANT VIEW HOMES, CONTRA COSTA
PLAN - 3.
TRACED BY CFC 9-20-50
REVISED BY CFC 4-15-51
REVISED BY CFC 4-1-52
REVISED BY CFC 1-4-56
REVISED BY CFC RCG
REDRAWN BY GEC 1-23-62
MAP TRACED FROM MAP OF CENTRAL CONTRA COSTA SANITARY DISTRICT (DIST 1) ORIG. 9-23-48
SHEET NO. 1.
Revised 4-8-77 L.D.